


Product

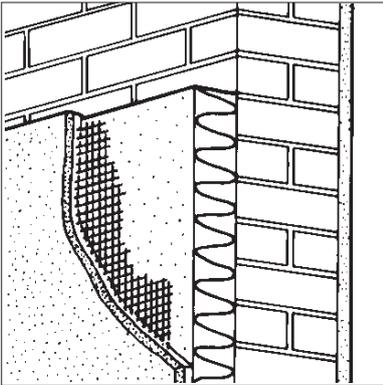

• THIS CONFIRMATION DETAIL SHEET RELATES TO THE ALSECCO ANB100 EXTERNAL WALL INSULATION SYSTEM, A SYSTEM EMPLOYING MINERAL WOOL OR LAMELLA MINERAL WOOL INSULATION SLABS, AND GLASS-FIBRE REINFORCING MESH WITH RENDER FINISHES.

- The system is applied to the outside of external walls of masonry or dense concrete construction and is suitable for new or existing buildings.
- It is essential that the ANB100 system is installed and maintained in accordance with the conditions set out in the Design Data and Installation parts of this Certificate.
- See the Appendix for system summary.

This Detail Sheet must be read in conjunction with the Front Sheets, which give the system's position regarding the Building Regulations, general information relating to the product, and the Conditions of Certification.

Confirmation of KOMO Certificate ATT0201/94 issued by BV Kwaliteitsverklaringen Bouw (BKB) to Alsecco GmbH & Co.KG, Kupferstrasse 50, D-36208 Wildeck-Richelsdorf, Germany.

Technical Specification

1 Description

1.1 The Alsecco ANB100 External Wall Insulation System (see Figure 1) comprises:

- (1) Thermastick MK and MP — cement based ready mixed adhesives supplied as a powder to which clean water is added. Comprises limestone sand conforming to BS 1199 and 1200 : 1976, cement to BS 12 : 1991 and additives.
- (2) Mineral wool insulation slabs — 1200 mm by 600 mm in a range of thicknesses from 20 mm to 120 mm, with a nominal density of 140 kgm⁻³.
- (3) Mineral wool lamella insulation slabs — 1200 mm by 200 mm in a range of thicknesses from 40 mm to 120 mm, with a nominal density of 95 kgm⁻³.
- (4) Alsecco Glass-fibre Mesh 33 — a one metre wide mesh of multi-stranded alkali-resistant glass fibres, having a polymer coating and a nominal weight of 210 gm⁻².
- (5) Litewall ANB A — a cement based ready mixed basecoat or topcoat supplied as a powder to which clean water is added. Comprises limestone sand conforming to BS 1199 and 1200 : 1976, cement to BS 12 : 1991 and additives.
- (6) Litewall ANB F — a cement based ready mixed basecoat or topcoat supplied as a powder to which clean water is added. Comprises limestone sand conforming to BS 1199 and 1200 : 1976, cement to BS 12 : 1991 and additives.
- (7) Litewall ANB K — a cement based ready mixed topcoat supplied as a powder to which clean water is added. Comprises limestone sand conforming to BS 1199 and 1200 : 1976, cement to BS 12 : 1991 and additives.
- (8) Litewall ANB T — a cement based ready mixed topcoat supplied as a powder to which clean water is added. Comprises limestone sand conforming to BS 1199 and 1200 : 1976, cement to BS 12 : 1991 and additives.
- (9) Ancillary materials:
Alsecco profiles comprising aluminium base profile, aluminium or stainless steel edge profile, stainless steel extension profile, aluminium, stainless steel or galvanized corner profile with optional PVC-U nosing, aluminium, galvanized or stainless steel render stop profile, aluminium movement joint and aluminium or PVC-U expansion joint.
Alsecco profile fixings as approved by the BBA and Alsecco (U.K.) Ltd.

Alsecco mechanical fixing comprising a polyethylene ribbed fixing with a stainless steel, galvanized steel, polypropylene or nylon central pin.

Mechanical fixings are approved by the BBA and Alsecco (U.K.) Ltd.

Alsecco sealing tape comprising precompressed expanding polyurethane foam tape.

Alsecco joint sealant comprising an acrylic based sealant.

1.2 The system comprises components selected from Table 1. Insulation slabs are fixed to the external surface of the wall using the ThermaStick MK or MP adhesive (see Figure 2). The insulation slabs are protected by a basecoat containing a glass-fibre reinforcement mesh. After allowing the basecoat to dry, a top coat is applied to the required thickness.

1.3 All components are subject to routine in-factory quality control.

Components	Title
Adhesive	ThermaStick MK or MP
Insulation	mineral wool HD or lamella
Basecoat	Litewall ANB A or Litewall ANB F ⁽¹⁾
Reinforcement	Alsecco Glass-fibre Mesh 33
Finish coat	Litewall ANB A Litewall ANB F Litewall ANB K Litewall ANB T

(1) May be used as an alternative basecoat if the finish coat is Litewall ANB A, Litewall ANB F or Litewall ANB T.

Figure 1 The Alsecco ANB100 External Wall Insulation System


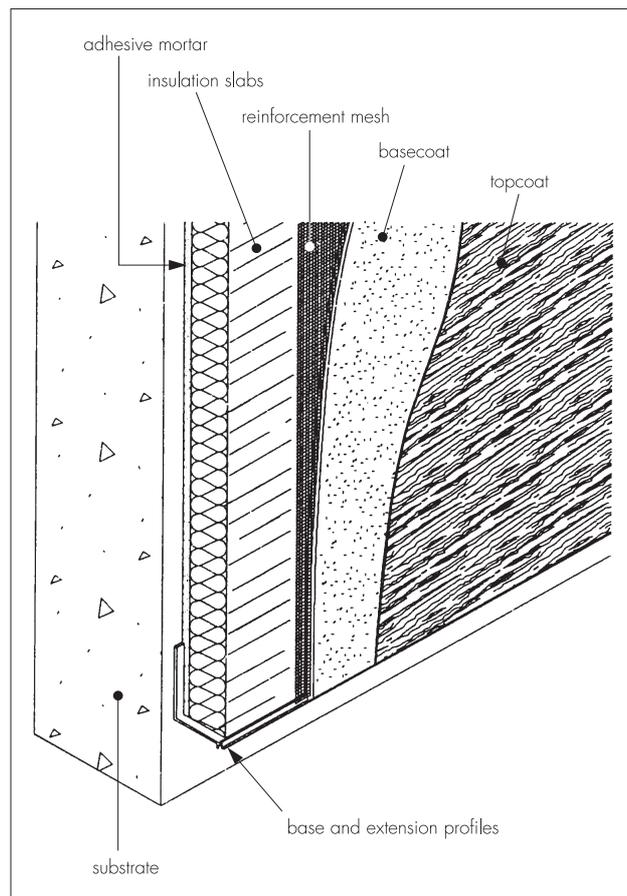


Figure 2 Typical section at base level

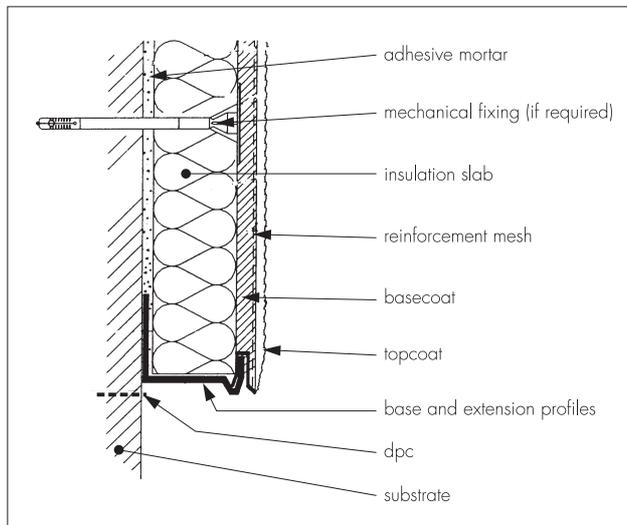

2 Delivery and site storage

2.1 The insulation is delivered to site wrapped in polythene. Each pack carries the product identification and batch numbers.

2.2 Components are delivered to site in the bags and quantities as listed in Table 2. Each bag carries the product identification, manufacturer's batch number and the BBA identification mark incorporating the number of this Certificate.

2.3 The insulation should be stored on a firm, clean, level base, off the ground and under cover until required for use. Care must be taken when handling the insulation to avoid damage.

2.4 The powder adhesives, basecoat and topcoats must be stored in dry conditions, off the ground, and be protected from moisture.

Table 2 Component supply details

Component	Quantity and packaging
Adhesives and topcoats	25 kg paper bag
Alsecco Glass-fibre Mesh 33	1 metre wide rolls, 50 metre length

Design Data

3 Strength and stability

3.1 The Alsecco ANB100 External Wall Insulation System has adequate resistance to impact and abrasion where walls are exposed and have some protection, eg walls of private dwellings and walls of communal dwellings above ground-floor level. Where the system may be exposed to severe impact, eg mechanical or malicious, precautions may be required to reduce the risk of damage (see section 7.3 of this Detail Sheet).

3.2 The system as specified in this Detail Sheet can be designed to withstand the thermal stresses and wind pressures (including suction) normally experienced in the United Kingdom. The system

can also be designed in accordance with CP 3 : Chapter V : Part 2 : 1972 or BS 6399 : Part 2 : 1995 to withstand the increased wind loads associated with tall buildings (greater than 12 metres) and areas of high exposure. This may require the use of additional mechanical fixings.

4 Properties in relation to fire



4.1 In the opinion of the BBA the use of the system will not introduce any additional hazard in respect of behaviour in fire when compared with a system using traditional sand/cement render finishes.

4.2 The system is classified Class 0 as described in paragraph A12 of Approved Document B of the Building Regulations 1991 (as amended 1994) (England and Wales), the Appendix to Part D of Technical Standards for compliance with the Building Standards (Scotland) Regulations 1990 (as amended) and paragraph 2.4 of Technical Booklet E to the Building Regulations (Northern Ireland) 1994 (as amended 1995).

4.3 The behaviour in fire of external wall insulation systems is the subject of recommendations by the Building Research Establishment which, for this system, makes no restriction on the height of building to be treated.

5 Proximity of flames

With this system there is no provision to be met.

6 Thermal insulation

6.1 For the purpose of U value calculations to determine if the requirements of the Building, or other statutory, Regulations are met, the thermal conductivity (λ values) of the insulation may be taken as listed in Table 3.

Table 3 Thermal conductivity values

Insulation	λ values ($\text{Wm}^{-1}\text{K}^{-1}$)
mineral wool	0.036
lamella	0.040



6.2 The requirement for limiting the heat loss through the building fabric will be satisfied if the U values of the building elements do not exceed the maximum values in the relevant Elemental Approach given in:

Approved Document L1 to the Building Regulations 1991 (as amended 1994) (England and Wales), or Part J of the Technical Standards for compliance with the Building Standards (Scotland) Regulations 1990 (as amended), or

Technical booklet F to the Building Regulations (Northern Ireland) 1994 (as amended 1995).

6.3 Guidance is also given in these documents on selecting the thickness of insulation required to enable a wall to achieve the desired U value. Alternative approaches are also described which

allow for some flexibility in design of U values for individual constructional elements.



6.4 For constructions subject to the Building Regulations 1991 (as amended 1994) (England and Wales) the effect of thermal bridges should be taken into account in any U value calculations.

6.5 Where insulation slabs have not been continued into window or door reveals due to a lack of clearance there will be a risk of cold bridging at these points. Where door and window frames are to be replaced it is recommended that their size be adjusted to permit the reveals to be insulated.

6.6 Depending on constructional details, cold bridging can also occur at the eaves and at ground-floor level, and care should be taken to minimise this, eg roof or loft insulation should continue over the wall head, ensuring that ventilation openings are not obstructed.

7 Durability



7.1 The results of accelerated ageing tests in accordance with MOAT No 22 : 1988 indicate that the system is durable. The system should remain effective for at least 30 years, provided any damage to the surface finish is repaired immediately, and regular maintenance is undertaken including checks on joints in the system and on external plumbing fittings to identify leakage of rainwater into the system, enabling steps to be taken to correct the defects.

7.2 The finishes may become soiled in time, the rate depending on the locality. The appearance can be restored by a powerwash at 30 bar maximum pressure and 30°C maximum temperature or, if required, by the application of a further finish of paint, but great care must be taken not to adversely affect the water vapour transmission characteristics of the systems.

7.3 Tests data indicate that when used in situations where walls are exposed but have some protection, eg walls of private dwellings and walls of communal dwellings above ground-floor level, the system has adequate resistance to possible damage. In other situations, eg walls of public buildings at ground-floor level, precautions may be required to reduce the risk of damage. Further information may be obtained from BRE Current Paper CP 6 : 81 *Assessment of external walls — Hard Body Impact Resistance*.

Installation

8 Procedure

General

8.1 Application is carried out in accordance with Alsecco (U.K.) Ltd's current installation instructions.

8.2 Application of coating materials must not be carried out at temperatures below 5°C or above 30°C, nor if exposure to frost is likely, and the coating must be protected from rapid drying. Weather conditions should therefore be monitored to ensure correct curing conditions.

8.3 All rendering should be in accordance with the relevant recommendations of BS 5262 : 1991.


Positioning and securing insulation boards

8.4 The base profile is secured to the external wall above the damp-proof course using the approved profile fixings at approximately 500 mm centres (see Figure 2). Base rail connectors are inserted at all rail joints. Extension profiles are fixed to the front lip of the base rail or stopend channel where appropriate.

8.5 Depending on the choice of system, Thermastick MK or MP is prepared by mixing each bag with 4.5 litres or 5.5 litres of water, respectively. For the lamella insulation the adhesive is applied over the entire face of the slab, using a notched trowel. For the mineral wool the same method may be used, or the adhesive may be applied in a continuous line around the perimeter of the slab with six additional dabs of adhesive distributed uniformly over the remaining surface. Using this method, the adhesive should cover at least 50% of the slab.

8.6 The slabs must be pressed firmly against the wall with the vertical joints staggered by at least 200 mm (see Figure 3). Care must be taken to ensure that all slab edges are butted tightly together, and alignment should be checked as work proceeds.

Figure 3 Arrangement of insulation boards

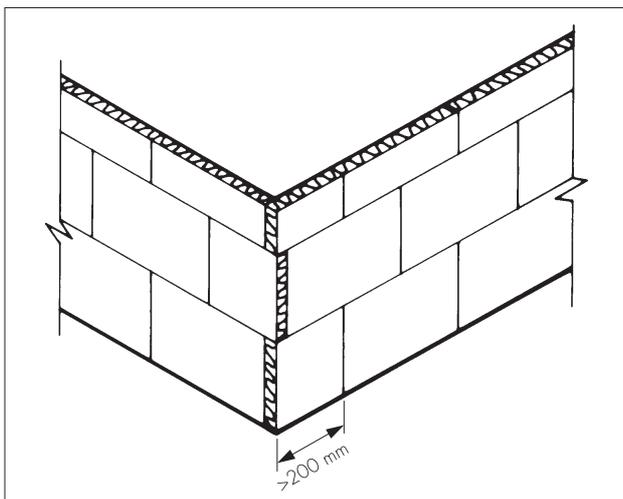

8.7 To fit around details such as doors and windows, the slabs may be cut with a sharp knife or a fine-tooth saw, and positioned so that the slab joints do not occur within 200 mm of the corners of the opening. If required, purpose-made window sills are fitted. They are designed to prevent water ingress and incorporate drips to shed water clear of the system.

8.8 Installation continues until the whole wall is completely covered including, where appropriate, the building soffits.

8.9 The adhesive must be allowed to set prior to rendering, mechanical fixing or any finishing work. The drying time will depend on weather conditions, but a minimum of 24 hours should be allowed.


8.10 Prior to the reinforcement coat, pre-compressed sealing tape is inserted at window and door frames, overhanging eaves, gas and electric meter boxes, wall vents, or where the render abuts any other building material or surface.

8.11 Angle beads are fixed to all building corners and to door and window heads and jambs using the basecoat renders.

Movement joints

8.12 Expansion beads are fixed vertically in agreed positions, depending upon the individual requirements of each job. Where an expansion joint is incorporated in the substrate, a movement joint must be provided in the insulation system (see Figure 4).

Figure 4 Vertical movement joint

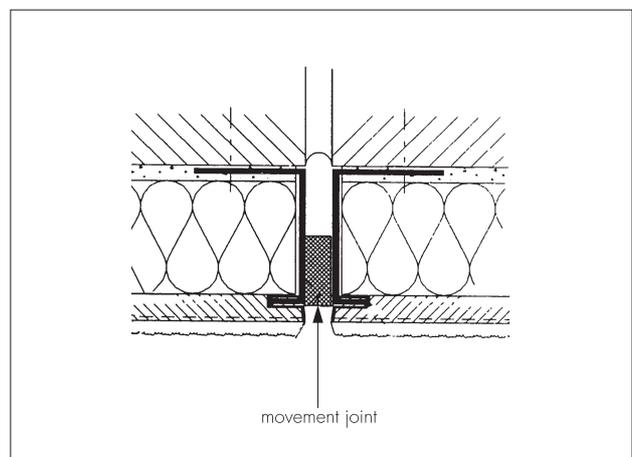

Reinforcing


8.13 The basecoats are prepared by mixing each bag with 16 to 17 litres of water. The material is applied over the insulation slabs, using a stainless steel trowel and floated with a Darby float to a minimum thickness of 5 mm and a maximum thickness of 18 mm. The reinforcement mesh is immediately embedded and a further 2 mm of basecoat is applied while still wet and smoothed off using a stainless steel trowel.

8.14 The basecoats are applied progressively, working in 1 metre sections in a vertical or horizontal direction.

8.15 Overlapping at all mesh joints should not be less than 100 mm.

8.16 Additional pieces of reinforcing mesh (250 mm by 250 mm) are used diagonally at the corners of openings, as shown in Figure 5.

Figure 5 Additional reinforcement at openings

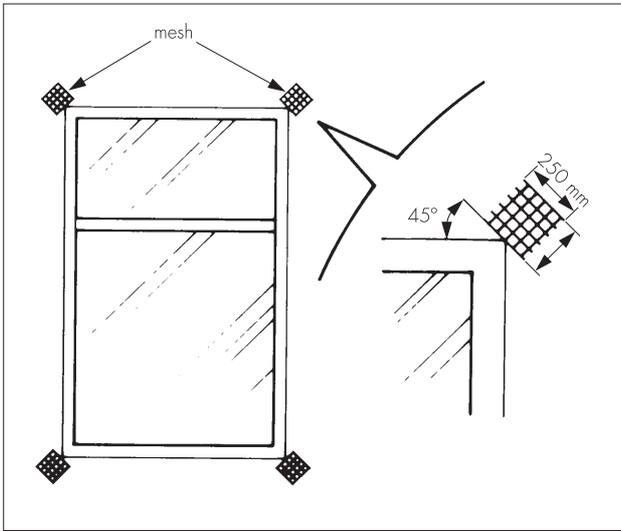

8.17 The mesh should be free of wrinkles and fully embedded in the basecoat.

8.18 Prior to the render coat, a bead of joint sealant is gun applied at window and door frames, overhanging eaves, gas and electric meter boxes, wall vents, or where the render abuts any other building material or surface.

8.19 Stop beads are positioned vertically, eg at party wall positions where the adjoining house does not require treatment.

Finishing

8.20 The basecoats should be left to dry thoroughly before application of the decorative finishes. Depending on conditions the drying time should be at least 24 hours before applying the finish coats.

8.21 The finish coats are applied to the thicknesses specified in Table 3, using a stainless steel trowel.


Table 3 Minimum thickness and application method for the finish coats

Finish coat	Application method	Minimum thickness (mm)
Litewall ANB A	applied with a stainless steel trowel and finished with a plastic trowel to create a texture finish	3
Litewall ANB F	applied with a stainless steel trowel or by machine and finished using a sponge pad to create a smooth finish	4 to 5
Litewall ANB K	applied with a stainless steel trowel and scraped with a nail board before the render sets to create a texture finish	10
Litewall ANB T	applied with a stainless steel trowel and finished with a plastic trowel to create a texture finish	3

8.22 Continuous surfaces should be completed without a break.

8.23 At the tops of walls the system should be protected by an adequate overhang (see Figure 6) or by an adequately sealed purpose-made flashing.

Figure 6 Roof eaves detail

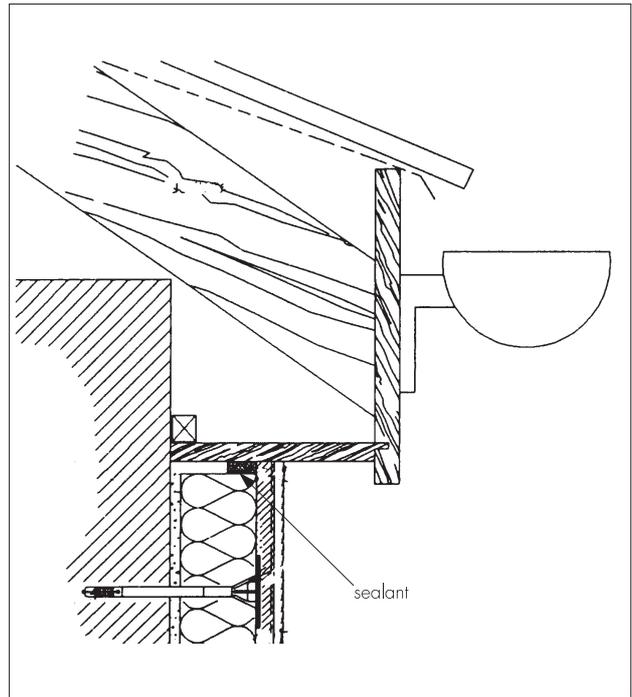

8.24 Care should be taken in the detailing of the system around openings and projections (see Figures 7, 8 and 9).

8.25 On completion of the installation, external fittings, eg rainwater goods, are securely fixed to timber grounds or extended fixings that have been built into the system during installation.

Figure 7 Insulated window detail

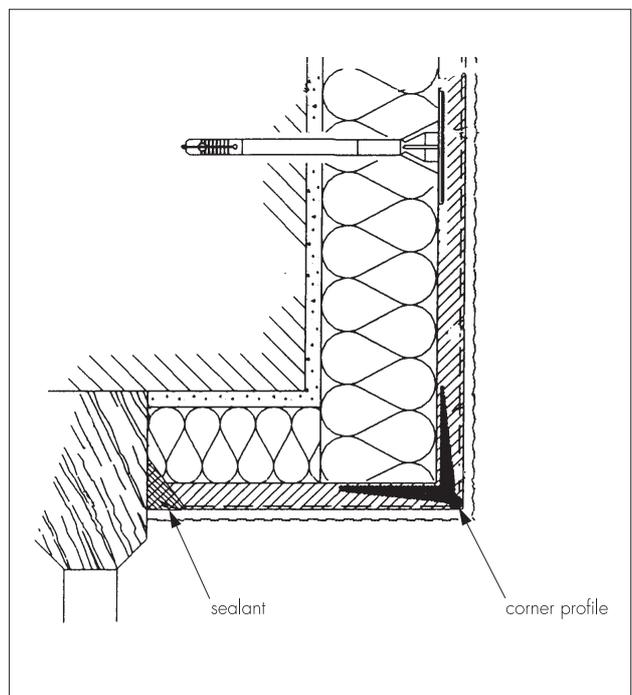


Figure 8 External corner detail


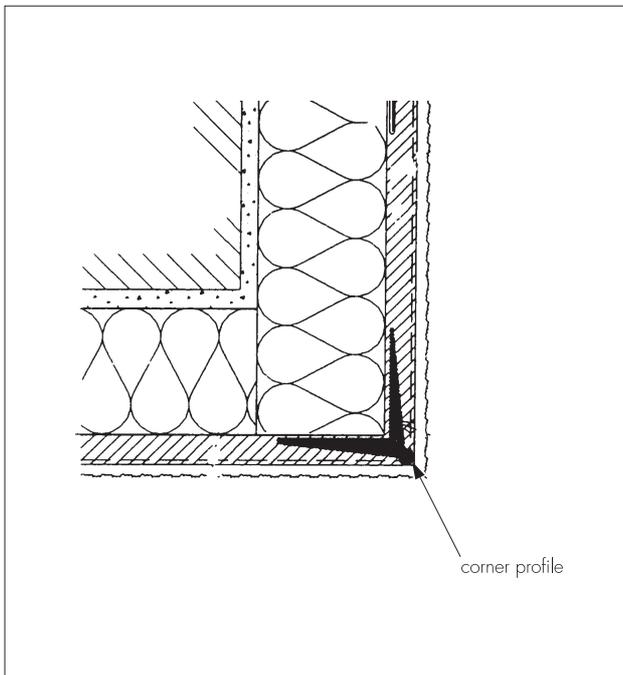


Figure 9 Window sill detail

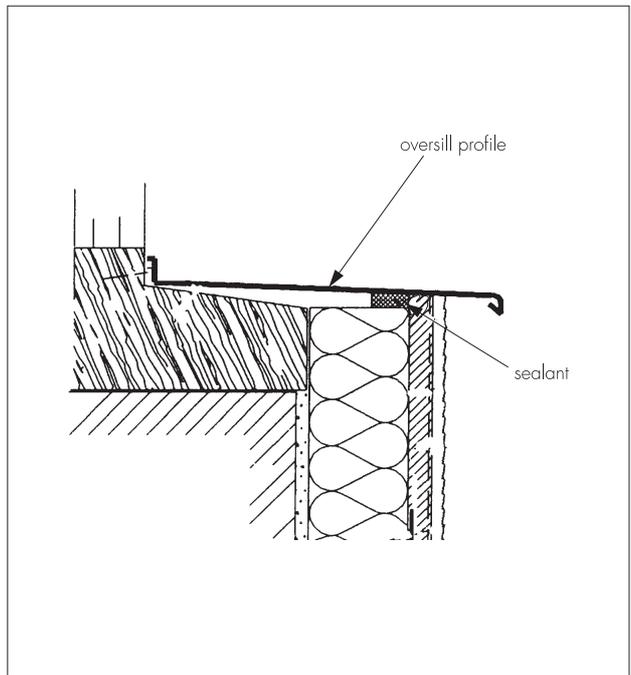

Technical Investigations

The following is a summary of the technical investigations carried out on The Alsecco ANB100 External Wall Insulation System.

9 Investigations

9.1 The products were examined and assessed by BKB to determine:

fire performance
bond strength
hygrothermal performance
resistance to frost
resistance to impact
water vapour permeability.

9.2 An examination was made of data relating to:
fire propagation tests to BS 476 : Part 6 : 1989
surface spread of flame tests to BS 476 : Part 7 :
1987
thermal conductivity to BS 874 : Part 2 :
Section 2.1 : 1986.

10 Other investigations

10.1 The manufacturing process, the methods adopted for quality control of manufactured and bought-in components, and details of the quality and composition of the materials used, were examined.

10.2 Visits to existing sites were undertaken to assess durability.

Bibliography

- BS 12 : 1991 *Specification for Portland cement*
- BS 476 *Fire tests on building materials and structures*
Part 4 : 1970(1984) *Non-combustibility test for materials*
Part 6 : 1989 *Method of test for fire propagation for products*
Part 7 : 1987 *Method for classification of the surface spread of flame of products*
- BS 874 *Methods for determining thermal insulating properties*
Part 2 *Tests for thermal conductivity and related properties*
Section 2.1 : 1986 *Guarded hot-plate method*
- BS 1199 and 1200 : 1976 *Specifications for building sands from natural sources*
- BS 5262 : 1991 *Code of practice for external renderings*
- BS 6399 *Loading for buildings*
Part 2 : 1995 *Code of practice for wind loads*
- CP 3 *Code of basic data for the design of buildings*
Chapter V *Loadings*
Part 2 : 1972 *Wind loads*



On behalf of the British Board of Agrément

Date of issue: 6th December 1996

Director

Appendix — System summary

1 System

Adhesives	Thermastick MK and MP — a cement based ready mixed adhesive supplied as a powder to which clean water is added.
Insulation	Mineral wool insulation slabs — 1200 mm by 600 mm in a range of thicknesses from 20 mm to 120 mm, with a nominal density of 140 kgm^{-3} . Mineral wool lamella insulation slabs — 1200 mm by 200 mm in a range of thicknesses from 40 mm to 200 mm, with a nominal density of 95 kgm^{-3} .
Reinforcement	Mesh of multi-stranded, alkali-resistant glass fibres with a polymer coating — nominal weight of 210 gm^{-2} .
Basecoat	Litewall ANB A and F — a cement based ready mixed basecoat supplied as a powder to which clean water is added. Comprises limestone sand conforming to BS 1199 and 1200 : 1976, cement to BS 12 : 1991 and additives.
Finish coats	Litewall ANB A, F, K or T — a cement based ready mixed topcoat supplied as a powder to which clean water is added. Comprises limestone sand conforming to BS 1199 and 1200 : 1976, cement to BS 12 : 1991 and additives.

2 Thermal properties

Thermal conductivity of insulation slabs	Mineral wool can be taken as $0.036 \text{ Wm}^{-1}\text{K}^{-1}$ Mineral wool lamella can be taken as $0.040 \text{ Wm}^{-1}\text{K}^{-1}$
U values	Using values given in Table A15 of Approved Document L1 (1995 edition) to the Building Regulations 1991 (as amended 1994) (England and Wales), the thermal insulation values for a typical 225 mm brick external wall (density 1700 kgm^{-3}) with 10 mm plasterboard:

Insulation thickness (mm)	U value mineral wool ($\text{Wm}^{-2}\text{K}^{-1}$)	U value mineral wool lamella ($\text{Wm}^{-2}\text{K}^{-1}$)
20	0.85	—
40	—	0.62
50	0.50	0.53
60	0.44	0.47
70	0.39	0.42
100	0.29	0.32
120	0.25	0.28
150	—	0.23
200	—	0.18

3 Impact resistance

The system is suitable for use where walls are exposed but have some protection, eg walls of private dwellings and walls of communal dwellings above ground-floor level. Where the system may be exposed to severe impact, eg mechanical or malicious damage, precautions may be required to reduce the risk of damage.

4 Properties in relation to fire

The system is classified Class 0 as defined in the appropriate Building Regulations.

5 Design wind loading and resistance to suction⁽¹⁾

Using CP 3 : Chapter V : Part 2 : 1972, the system can be designed to withstand all expected suction wind loadings.

(1) BS 6399 : Part 2 : 1995 may also be used to generate design calculations.

6 Durability

Age of oldest installation	19 years in Germany.
Assessed life	At least 30 years (with normal maintenance).